



DETAIL
TERMINATION DETAIL FOR
COOPER SECTIONALIZING CABINET
SCALE: 3/4"=1'-0"



SECTION
600A ELBOW TERMINATION AT
SECTIONALIZING CABINET
SCALE: 3/4"=1'-0"

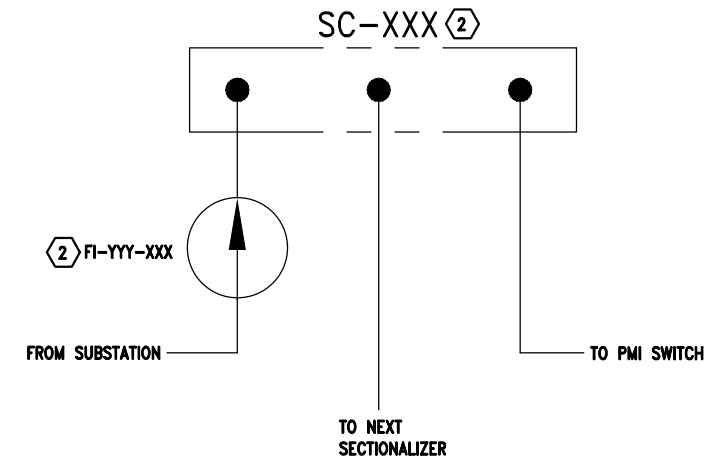

DETAIL
ONE-LINE DIAGRAM OF SECTIONALIZER
SCALE: N/A

KEYED NOTES:

- 1 REMOTE FAULT INDICATOR TO BE PLACED ON SIDE OF SECTIONALIZING CABINET OPPOSITE THE PMI SWITCH UNLESS DIRECTED OTHERWISE. SCHWEITZER PART NUMBER 3CRL-0800-IRACC OR APPROVED EQUAL. ADD 'W' TO PART NUMBER FOR TAMPER PROOF WINDOW KIT.
- 2 XXX = SWITCH VAULT OR MANHOLE NUMBER
YYY = FEEDER NUMBER
- 3 FASTEN CONTROL CABLES TO THE BACK OF THE ENCLOSURE WITH ADHESIVE TY-RAP ANCHORS AND TY-RAPS.
- 4 MOUNT FAULT INDICATOR PER MANUFACTURERS RECOMMENDATIONS. REFINISH EXPOSED STEEL EDGES OF HOLES TO MATCH THE EXISTING FINISH.

R E V I S I O N S					PROJECT MANAGER: —	<div>Port of Seattle</div> SEA-TAC INTERNATIONAL AIRPORT PROJECT: F&I STANDARD DETAILS SHEET TITLE: SECTIONALIZING CABINET DETAILS FAULT INDICATORS	WORK PROJECT NO.
NO.	DATE	BY	DESCRIPTION		PROJECT ENGINEER: —		CONSULTANT'S NO.
1	03/01/19	KDM	2019 F&I STANDARD DETAILS		DESIGN ENGINEER: —		
					DRAFTER: —		
					SCALE: AS NOTED		
					DATE: —		
					CHECKED/APPROVED BY: —		
							PORT OF SEATTLE NO.
					261800 02		